




Level measurement and leakage alarm control unit for waterproof level gauges and sensors MASTER LEVEL series AT11710 16 gauges

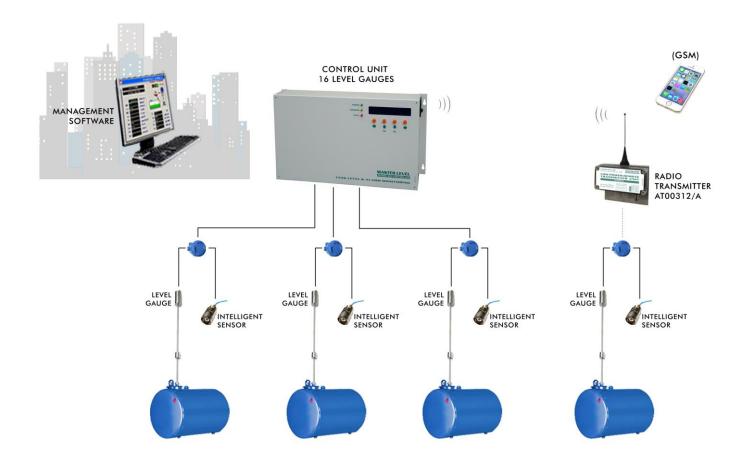

Level measurement and leakage alarm monitoring control unit for tanks, piping and wells. Management of 16 level guages and 32 leakage alarm sensors, 4/8 on/off inputs and up to 8 relays with programmable-event outputs. It can be connected to other 4 devices to extend the level, alarm and relay control and to allow interfacing with main control systems installed on refuelling stations.

The GSM/GPRS module, installed on a special slot (host 1), allows receiving alarm message and requiring product stock from one or more service stations or storehouses.

Using the MasterTank Tre software it is possible to centralise the collection of information for products stored in up to 128 remote systems.

Technical data

-	Bower europhy	100-240 VAC 50/60 Hz
•	Power supply	
•	Max. consumption	36 VA
•	Operating temperature	-10°C ÷ +40°C
•	Relative humidity	5% to 95% (without condensate)
•	N° of level guages that can be connected	16
•	N° of intelligent sensors that can be connected	32
	N° of ON/OFF auxiliary sensors that can be connected	4/8
•	Relay outputs	4/8
•	Output relay capacity	500 mA 24 VCC
	Remote serial communication (host)	RS232/RS485
	Auxiliary serial communication	RS232 LAN GSM/GPRS modem wireless radio
•	Remote printer communication	RS232
•	Container	Metal, fire-varnished
•	Dimensions	375x280x110 mm

Operation

 The main menu is composed of a list of selectable items: LEVELS, PRINTS, DIAGNOSIS and SETUP for the displaying the levels of the tanks, print mangagement, diagnosis and setup control units.

Programming and display from Host

- The control unit can be programmed using the following softwares **MasterLevelSetup** code ATS01008 or **GSetup** code ATS01811.
- It is possible, using the MasterTank Tre series software, code ATS03309, to remotely monitor (from the main office) up to 128 systems.

Safees Version 1.03	Constantion Constanti	N CONTRACTOR TO 2.5.5 (Contract On the Contract On the Contrac	
N02-23% H2O-7%	Openation Openation <t< th=""><th>TP1 Inplantol (***):</th></t<>	TP1 Inplantol (***):	
MasterLevelSetup	GSetup	MasterTank Tre	

Codes

AT11710	/TYPE	/DATA OUTPUT	/GAUGES	/ALARMS
* Possible v	A: basic B: with display and keyboard C: with display keyboard and printer G: with graphical display with converter, code AT13600/K	N: RS232/RS485 * S: second RS232 L: LAN G: GSM/GPRS modem R: wireless radio , to be purchased separate	16: 16 gauges ly	04/04: 4 inputs/4 outputs 08/08: 8 inputs/8outputs

Specification subject to change without notice

